


ROBERTS GORDON® Heating Controller – Ethernet IP

Parameters must be provided by the third party when connecting controller to BMS through Ethernet IP.

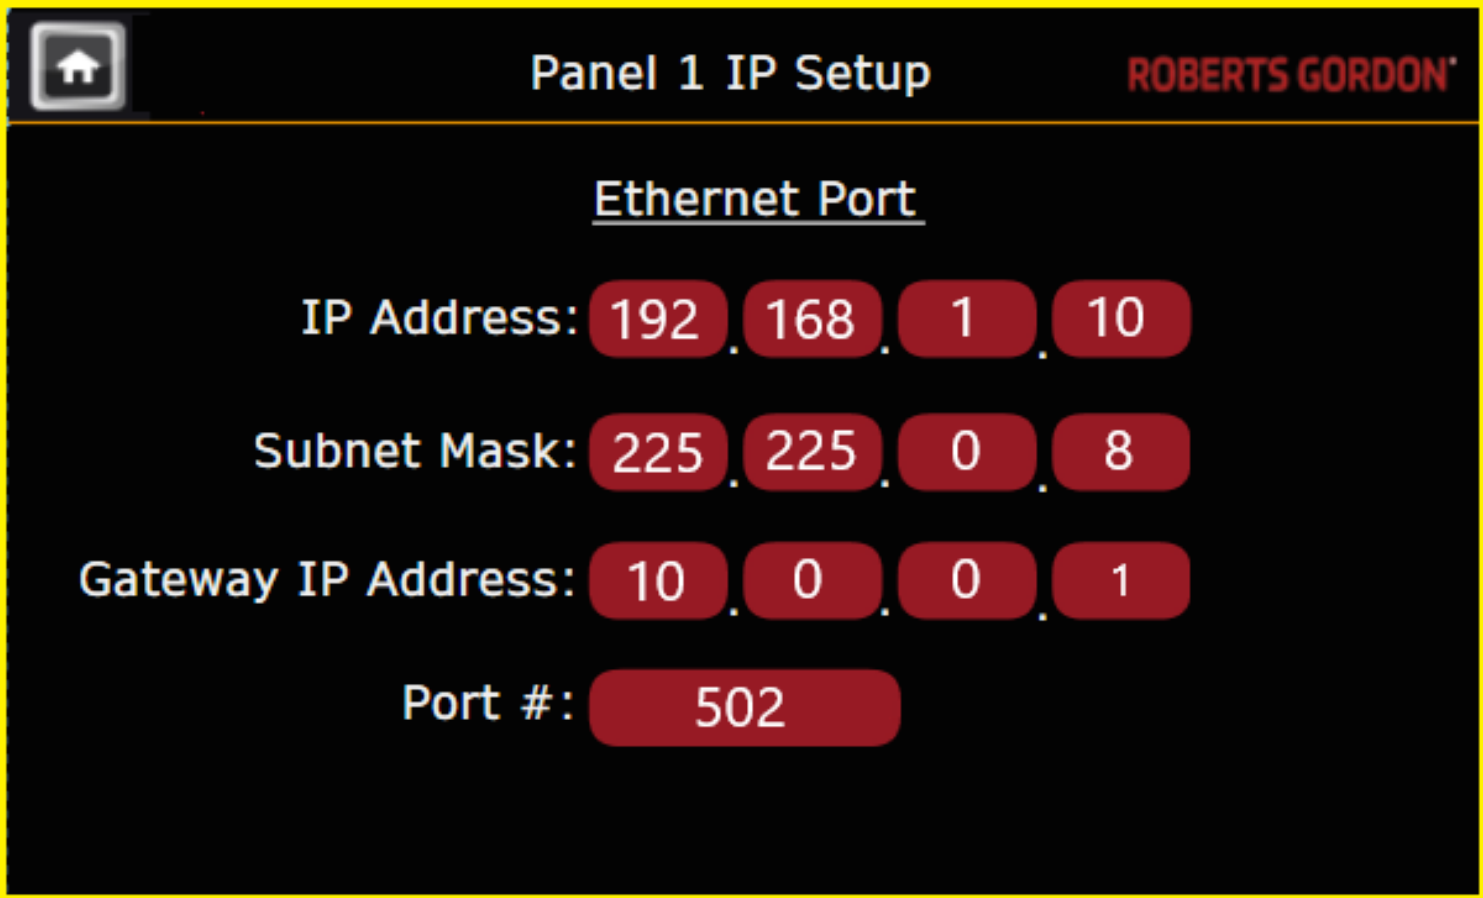

The screenshot displays the 'Panel 1 IP Setup' interface for a Roberts Gordon heating controller. The screen has a black background with a yellow border. At the top left is a home icon, and at the top right is the 'ROBERTS GORDON' logo. The title 'Panel 1 IP Setup' is centered at the top. Below the title, the text 'Ethernet Port' is underlined. The configuration parameters are as follows:

IP Address:	192	.	168	.	1	.	10
Subnet Mask:	225	.	225	.	0	.	8
Gateway IP Address:	10	.	0	.	0	.	1
Port #:	502						